


Installation: Recommended Clearances




Exposed Unheated & Electrically Heated Models

- **TOP**
2" Minimum
- **BOTTOM**
2" Minimum (Discharge cannot be blocked)
- **FRONT**
30" Minimum
- **BACK**
0" Minimum
- **SIDES**
1/2" Minimum
*FAC & CAC require 12" due to controller placement and junction box.
- **FOR EVE & MP-HW/ST, CED, ETA & ECE**
Minimum 6" on side for coils and 6" on top for junction box.

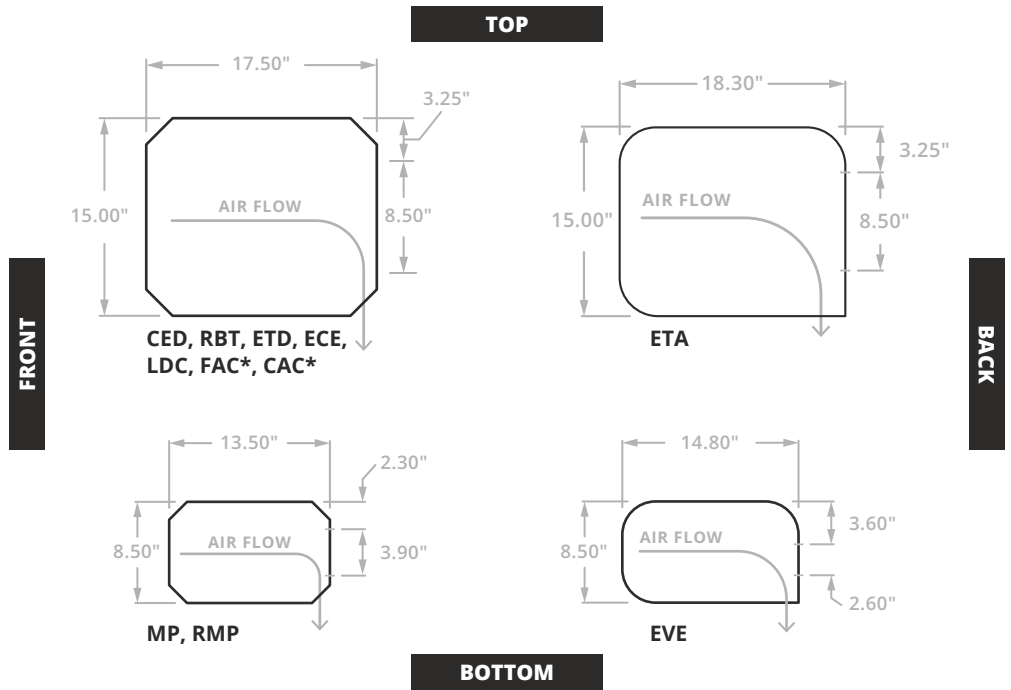

Chameleon Series: Unheated, Electric, Hot Water, & Steam Heated Models

- **TOP**
3" Minimum
- **BOTTOM**
6" Minimum (Discharge cannot be blocked); 30" min. if access is from bottom. No bottom access for HW or Steam.
- **FRONT**
30" min. if access is from the front. 3" min. if access is from the bottom.
- **BACK**
3" Minimum
- **SIDES**
3" minimum on side without junction box, 20" on side with J-box.

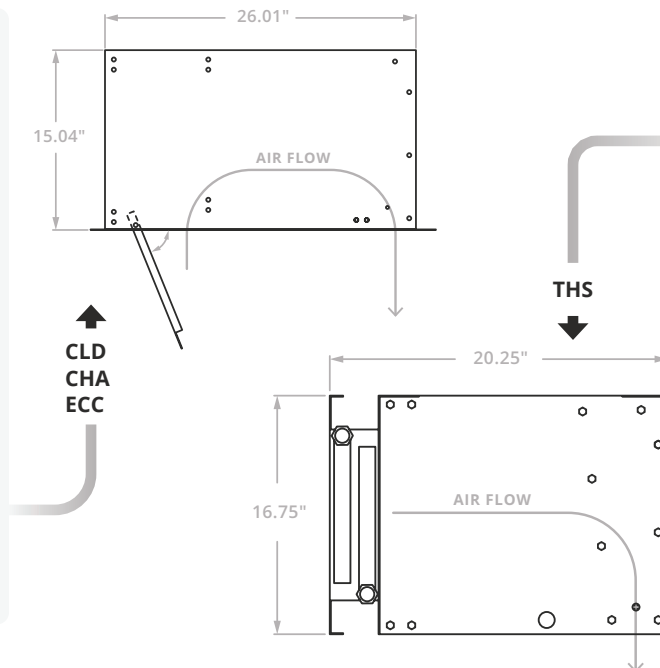

- **TOP**
2" min. if maintenance access is from bottom or front; 30" min. if access is from top.
- **BOTTOM**
2" Minimum (Discharge cannot be blocked)
- **FRONT**
12" min. if maintenance access is from top or bottom; 30" min. if access is from front. Coil must be removed for front access.
- **BACK**
Unit can be lagged directly to wall. If not, 2" min. required.
- **SIDES**
3" minimum on side without junction box, 20" on side with J-box.



Model dimensions vary. Refer to unit mechanicals for correct measurements. If you do not see your exact unit, please contact Powered Aire for clearance information: TechnicalSupport@PoweredAire.com